


SIEVE ANALYSIS TEST REPORT
BS 1377 : Part 2 : 1990

Report Number: 205
 Client: A D Bly Civil Engineering
 Site: aaa
 Location: Lab Ref.
 Date Sampled: 03/04/1998 Client Ref.
 Sampled from: Mass (kg):
 Description: 0
 Supplier: Tarmac
 Source : Whitwick Quarry
 Specification: Type 6 - Selected Granular Fill
 Date Received: 03/04/1998
 Sampled by:
 Method of Preparation: BS 1377 : Parts 1 & 2 : 1990
 Remarks:

SIEVE ANALYSIS		
BS Sieve (mm)	Passing (%)	Material Specification
150	100	
90	100	
75	100	100
37.5	94	75 - 100
28	94	
20	94	
14	94	
10	79	40 - 95
5.0	49	30 - 85
2.0	49	
1.18	49	
0.600	15	10 - 50
0.425	15	
0.300	15	
0.150	15	
0.063	5	0 - 15

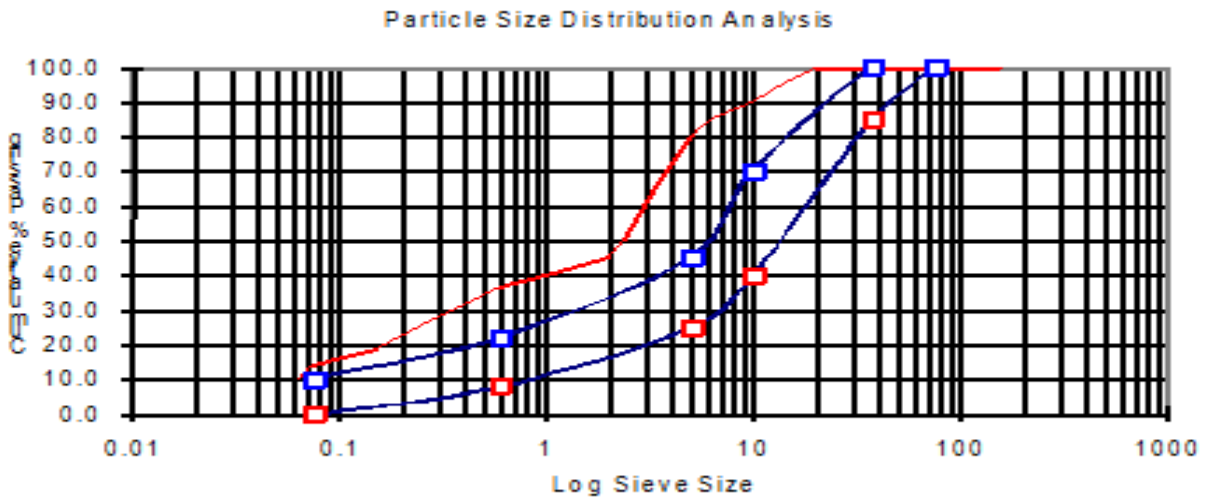

Certified that the Particle Size Distribution was determined in accordance with BS 1377 : Part 2 : 1990 : Method 9.2

Signed _____